



REVISION No. 9

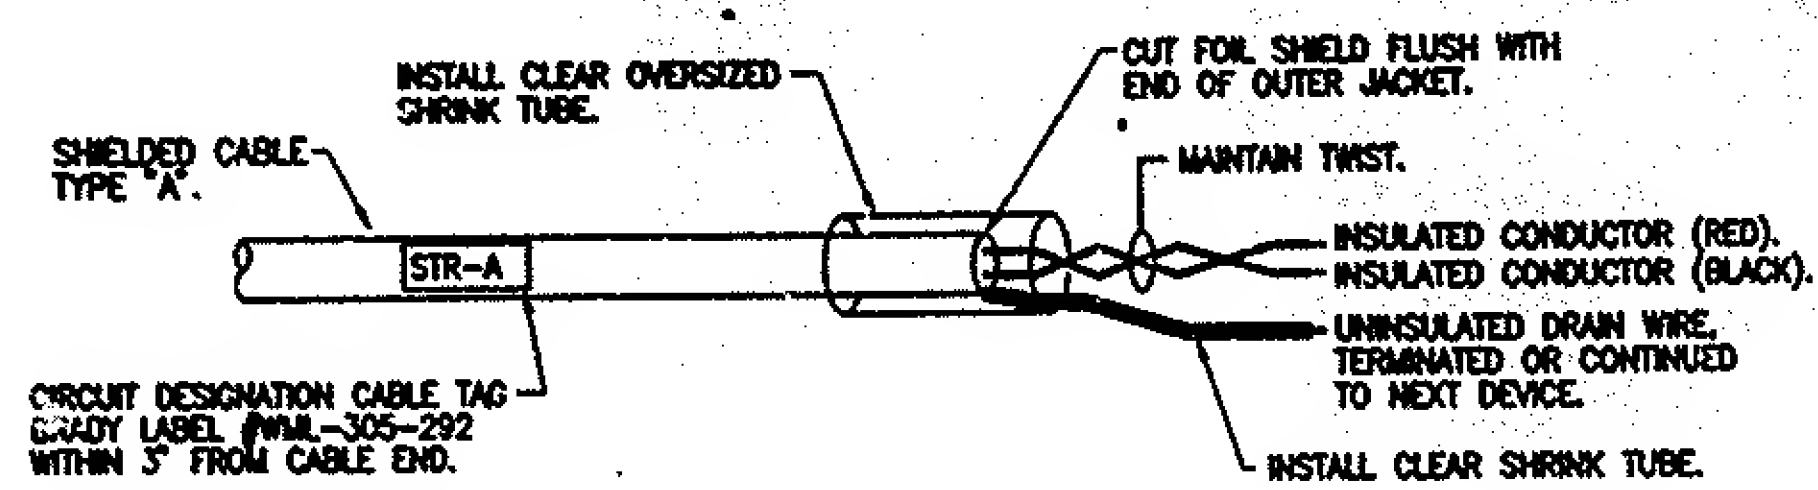


TYPICAL SHIELD/DRAIN INSULATING METHOD "A"

N.T.S.

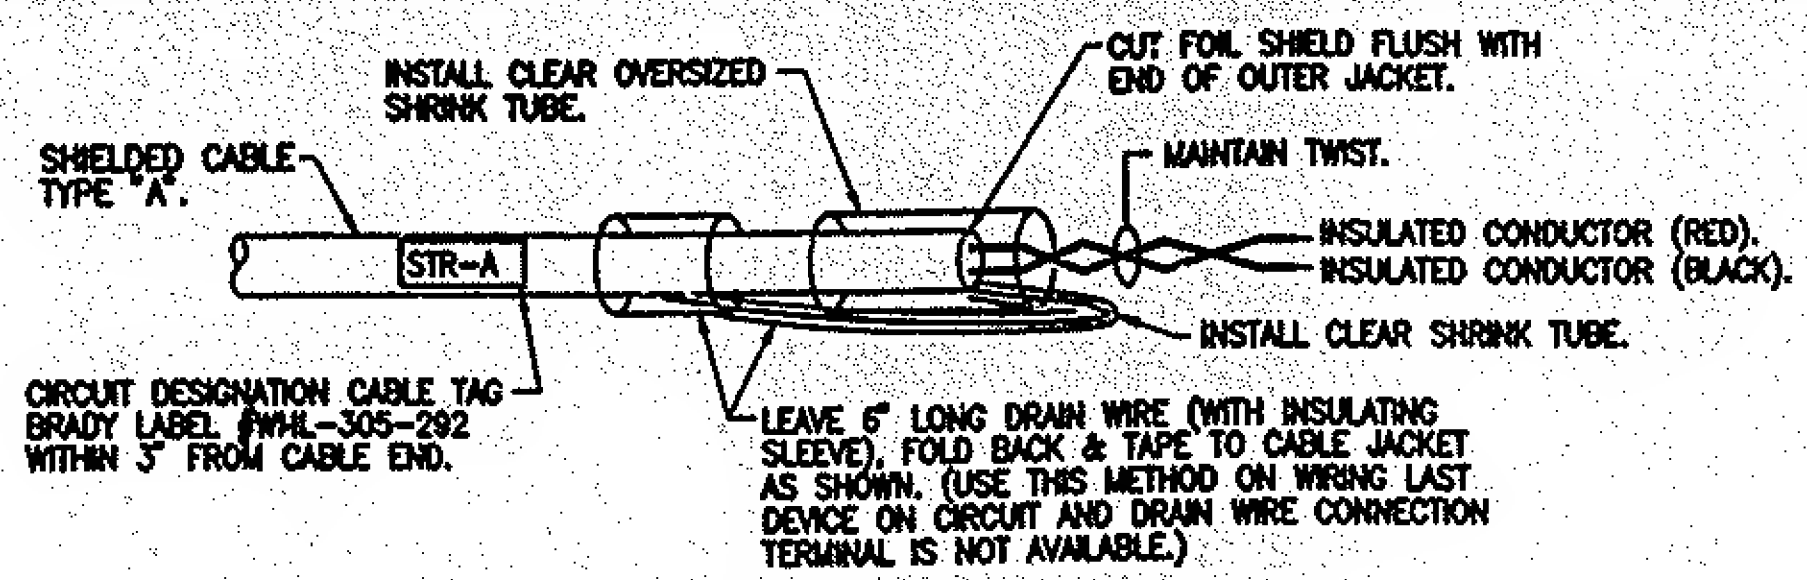


TYPICAL SHIELD/DRAIN INSULATING METHOD "B"

N.T.S.

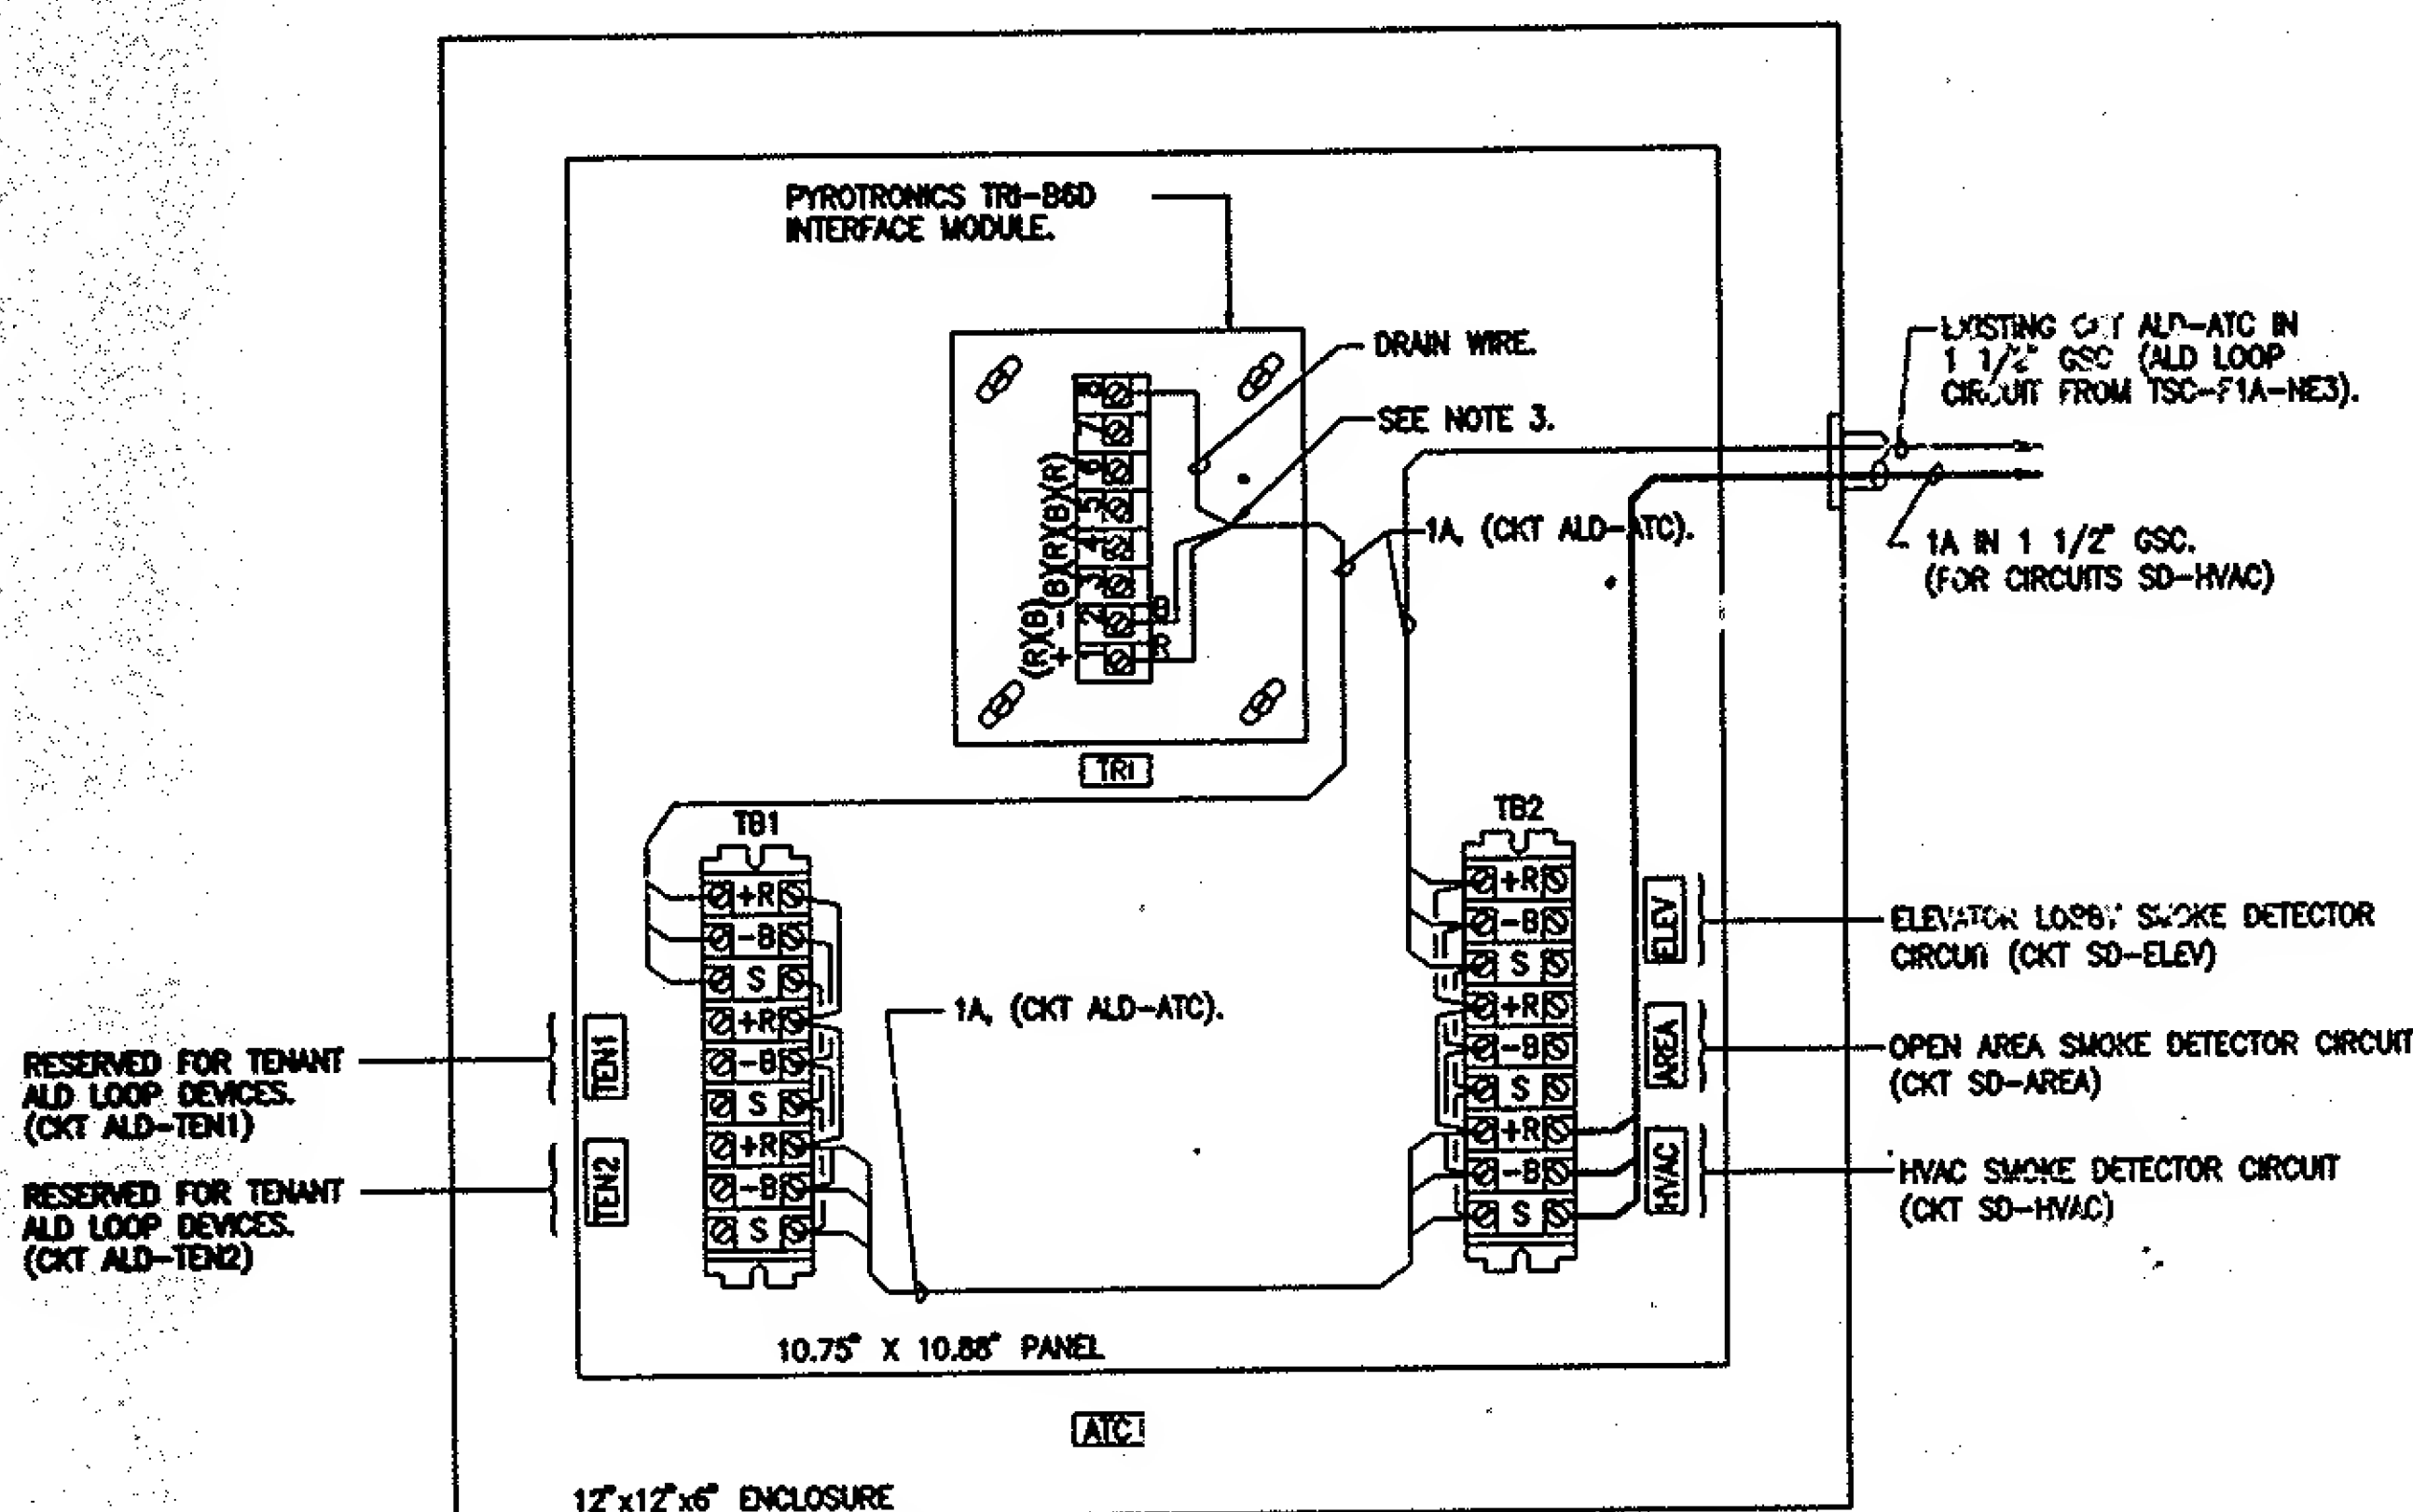


**ATC CABINET
TYPICAL BLOCK WIRING DIAGRAM**

N.T.S.

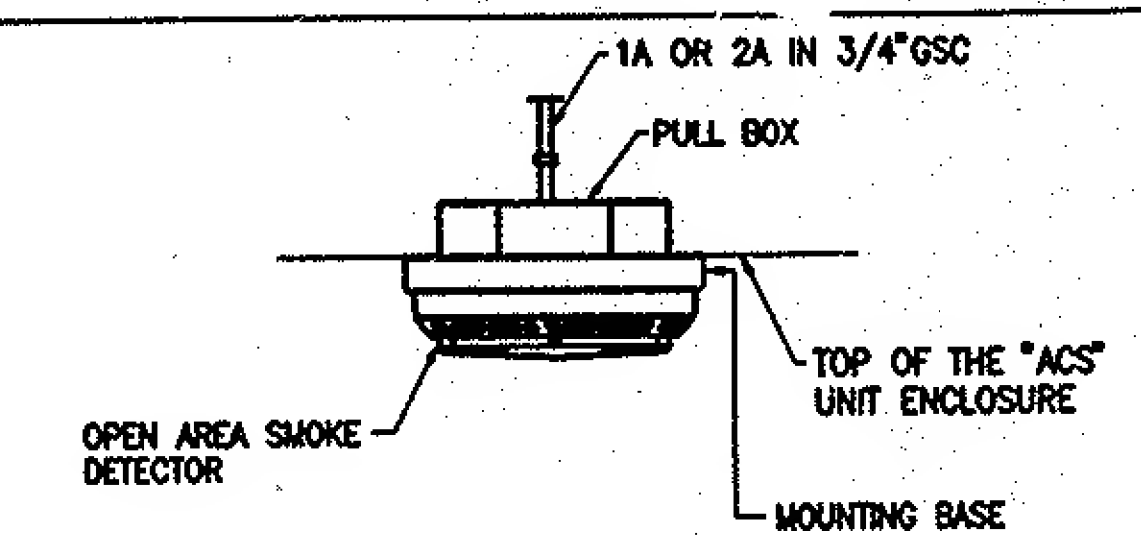


**AREA SMOKE DETECTOR INSTALLED
INSIDE THE "ACS" UNIT-DETAIL "C"**

N.T.S.

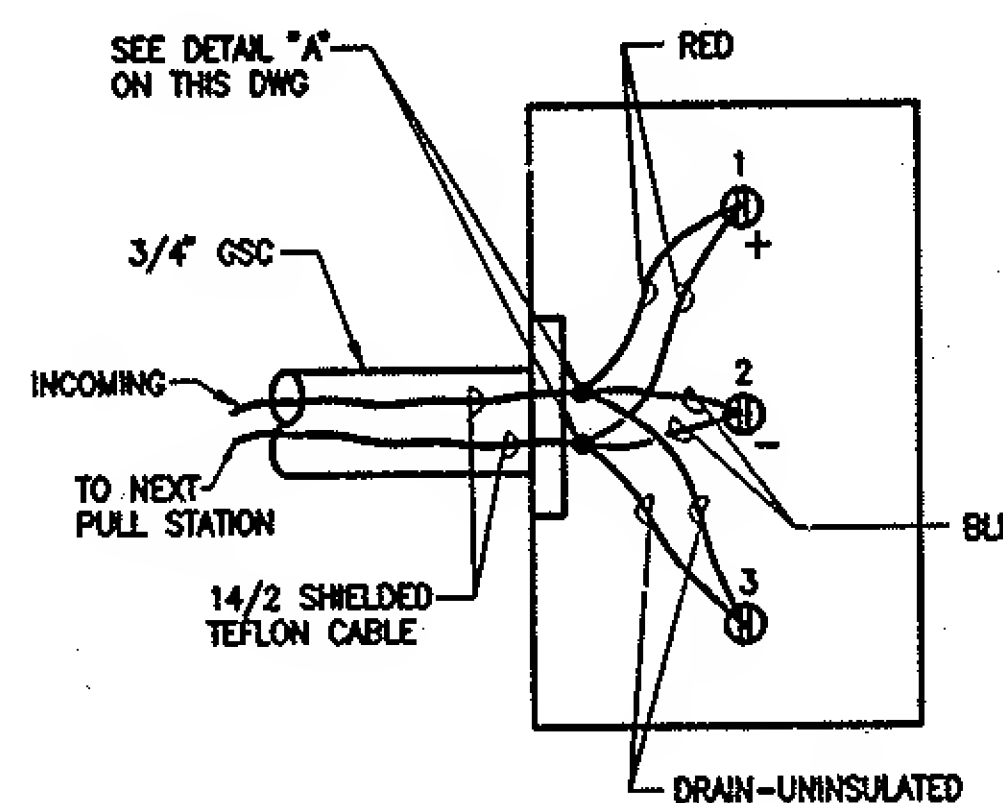


**PULL STATION
CONNECTION DIAGRAM**

N.T.S.

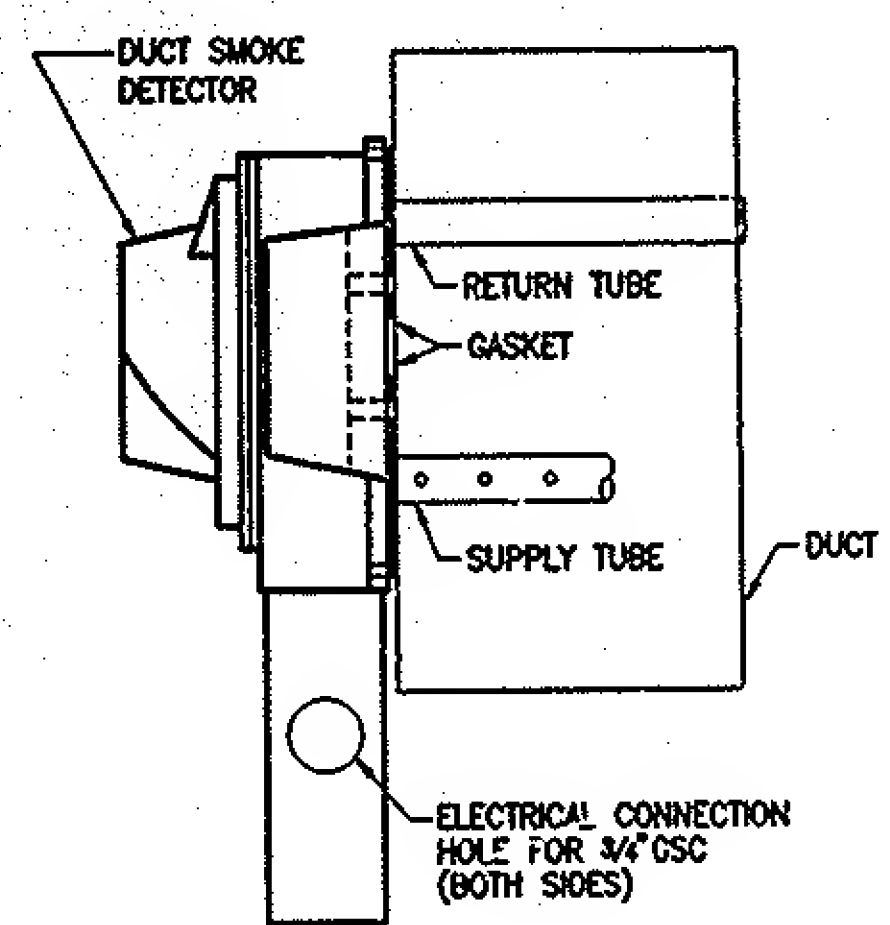



**DUCT SMOKE DETECTOR
MOUNTING DETAIL "D"**

N.T.S.

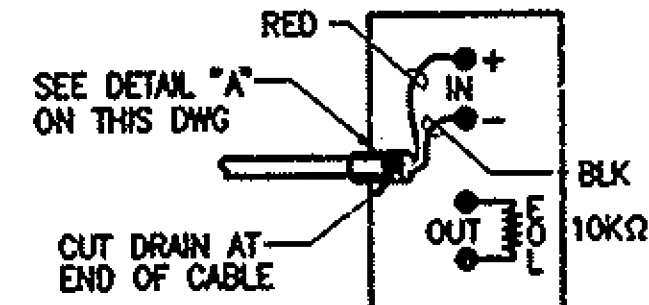



**WARDEN TELEPHONE
CONNECTION DIAGRAM**

N.T.S.

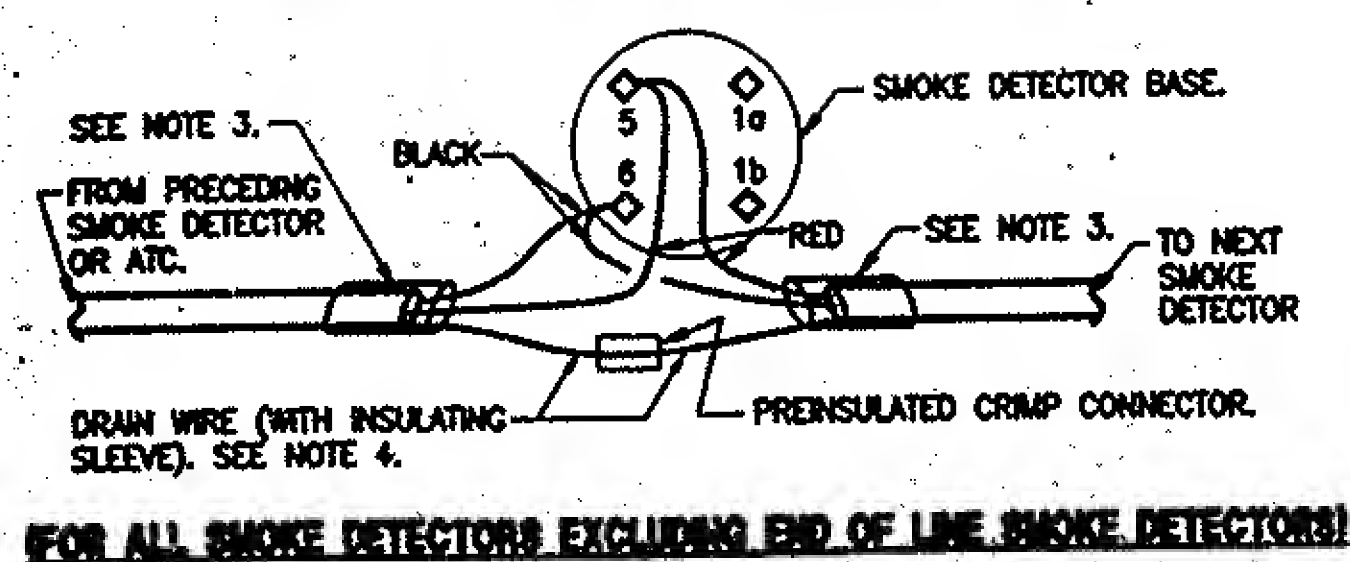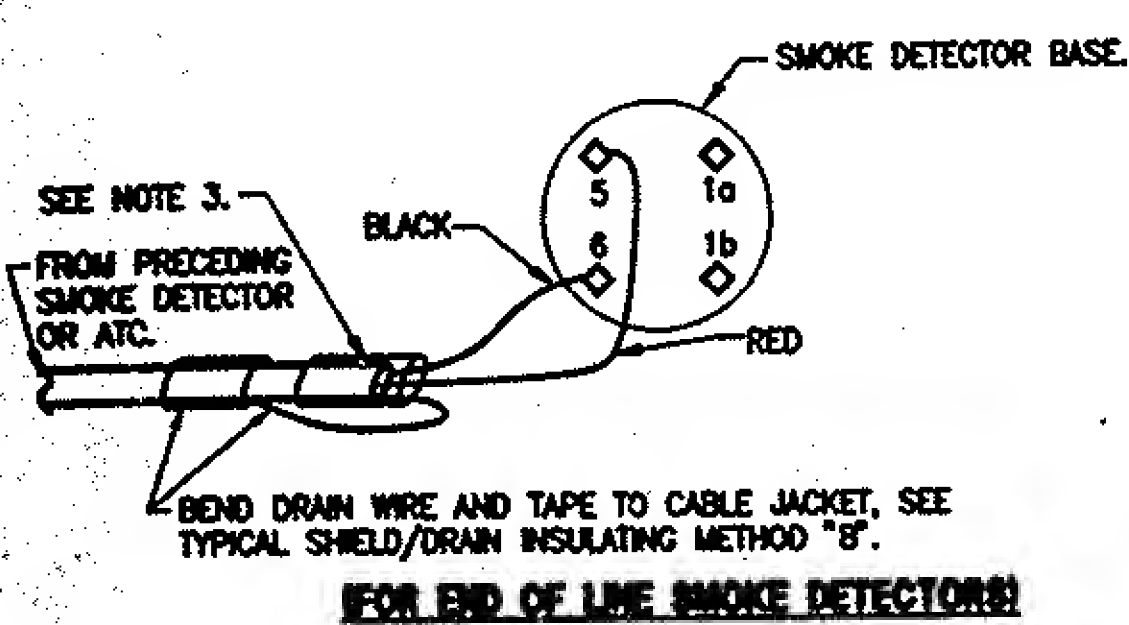



TYPICAL SMOKE DETECTOR WIRING DIAGRAM

N.T.S.

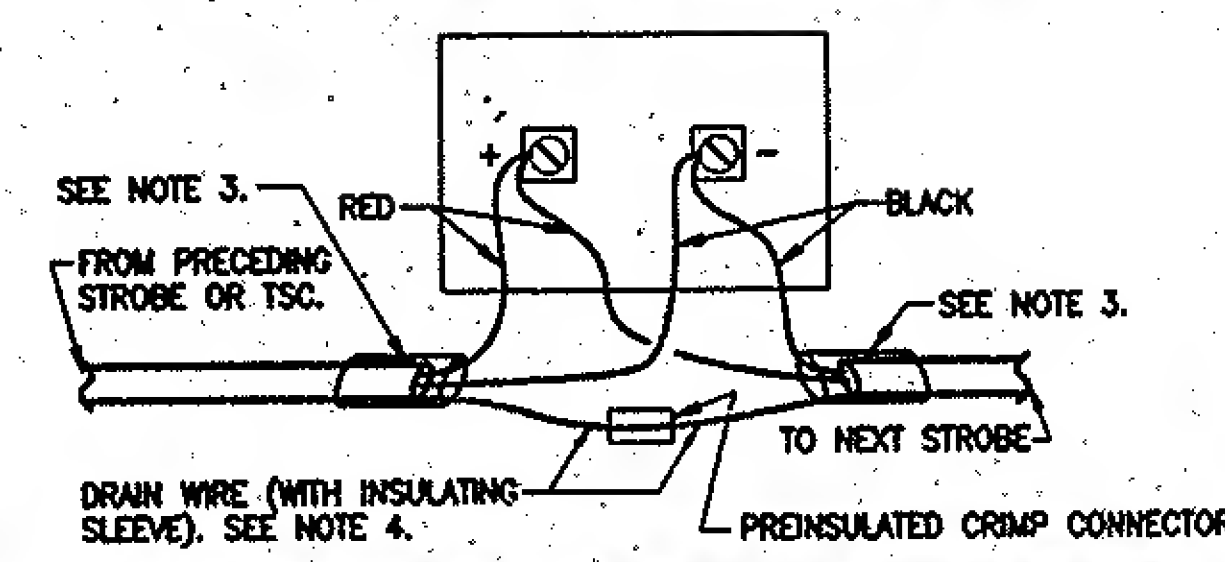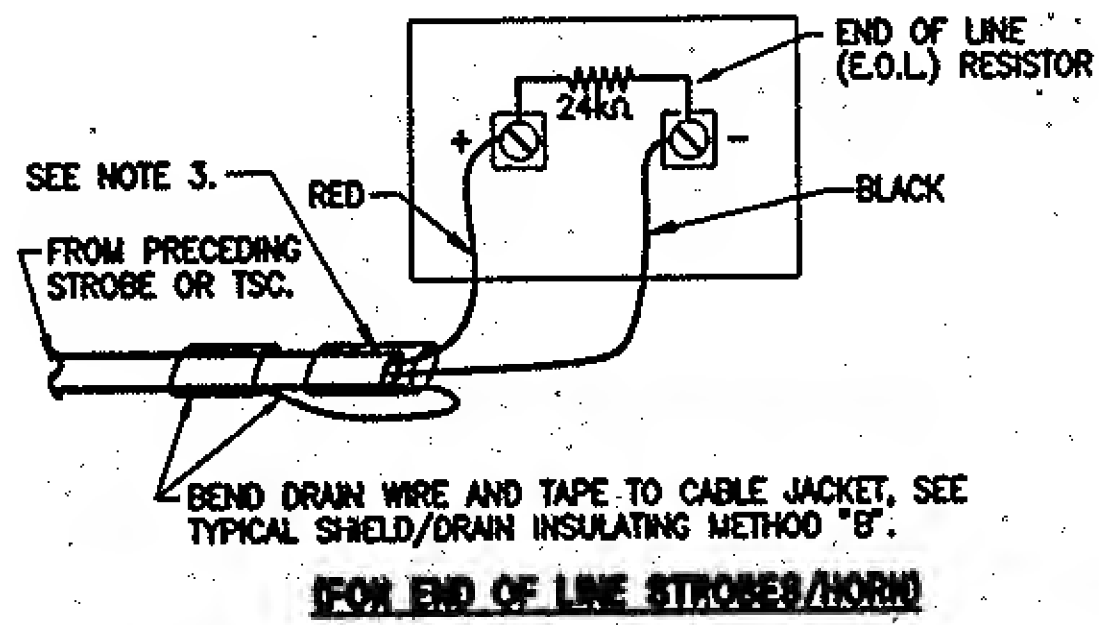

TYPICAL STROBE/HORN WIRING DIAGRAM

N.T.S.

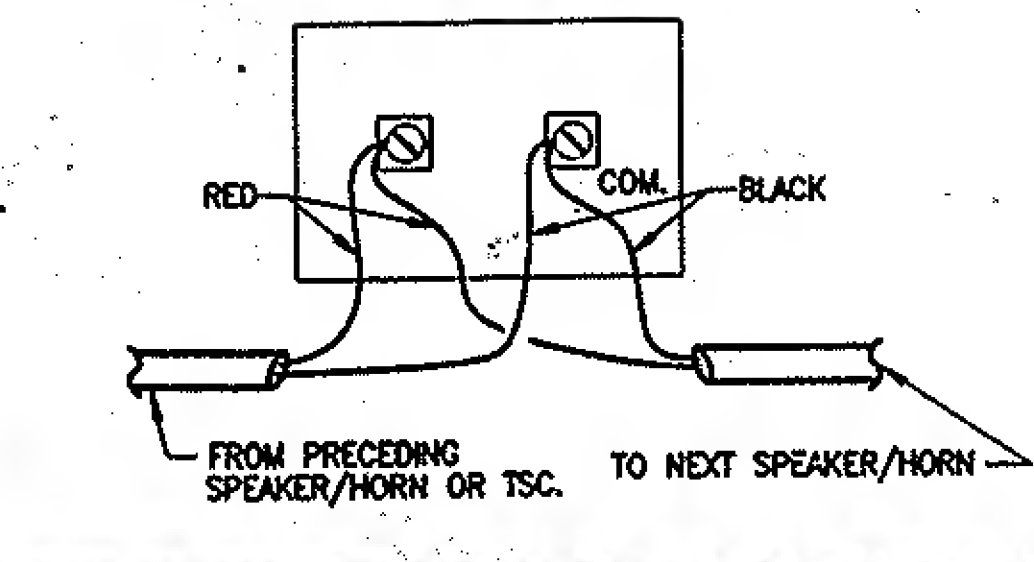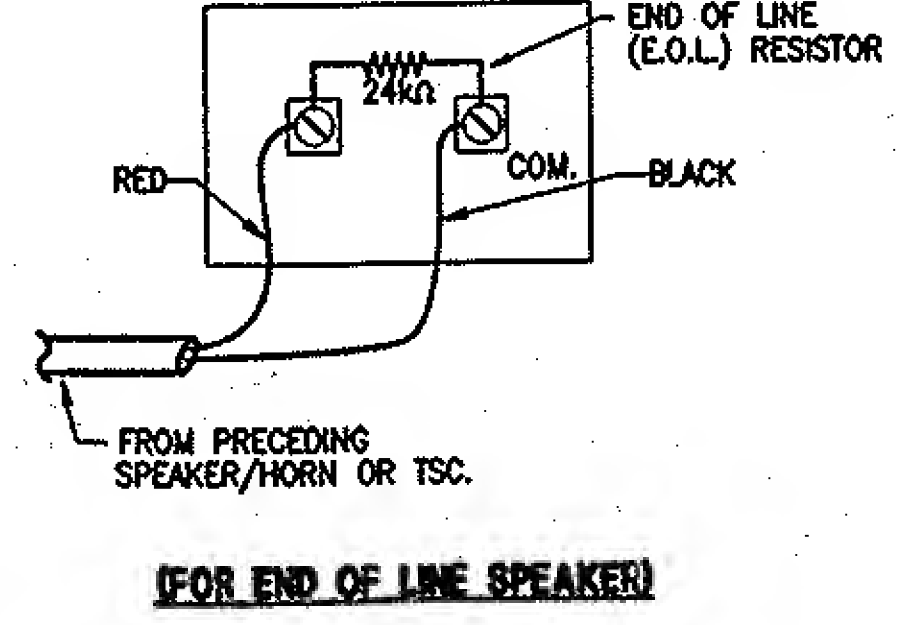

TYPICAL SPEAKER WIRING DIAGRAM

N.T.S.